




Zingonia
 Fan test laboratory
 AMCA 210/99 Fig. 12
 10000 m³/h test chamber

Air Density (γ): 1.20 kg/m³
 Installation type : free inlet, ducted outlet
 dB(A) free field noise measurements at 1 m

Type:	DDM 225/240	Watt:	300	Amp Max:	2.6
Motor:	E6G3313	Volt:	230 1~	Prot.:	IP 55
Test nr.:	2485.*	Hz:	50	T.H.:	YES-OUT
Date:	23/06/00	Poles:	4	Ins. Cl.:	F
		μ F:	10 / 450 V		

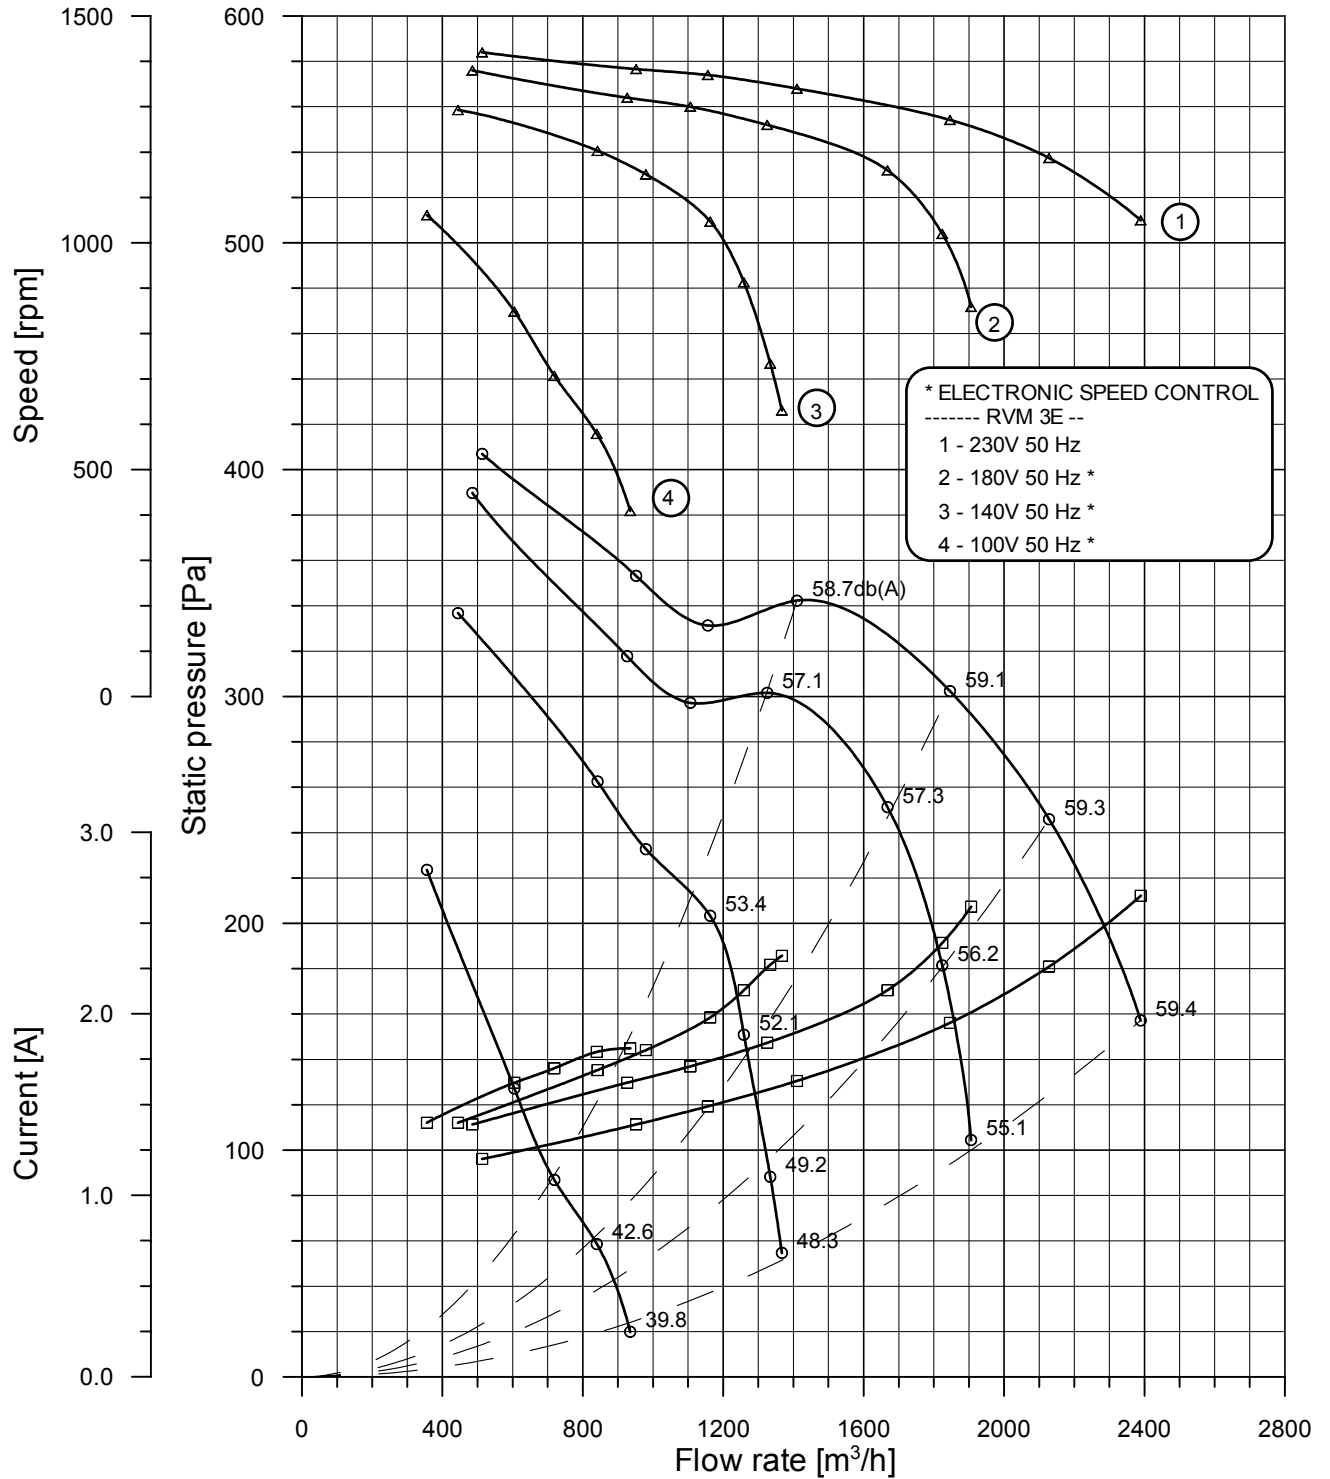


This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.



Zingonia
 Fan test laboratory
 AMCA 210/99 Fig. 12
 10000 m³/h test chamber

Air Density (γ): 1.20 kg/m³
 Installation type : free inlet, ducted outlet
 dB(A) free field noise measurements at 1 m

Type:	DDM 225/240	Watt:	300	Amp Max:	2.8
Motor:	E6G3313	Volt:	230 1~	Prot.:	IP 55
Test nr.:	2842.*	Hz:	60	T.H.:	YES-OUT
Date:	03/06/03	Poles:	4	Ins. Cl.:	F
		μ F:	10 / 450 V		

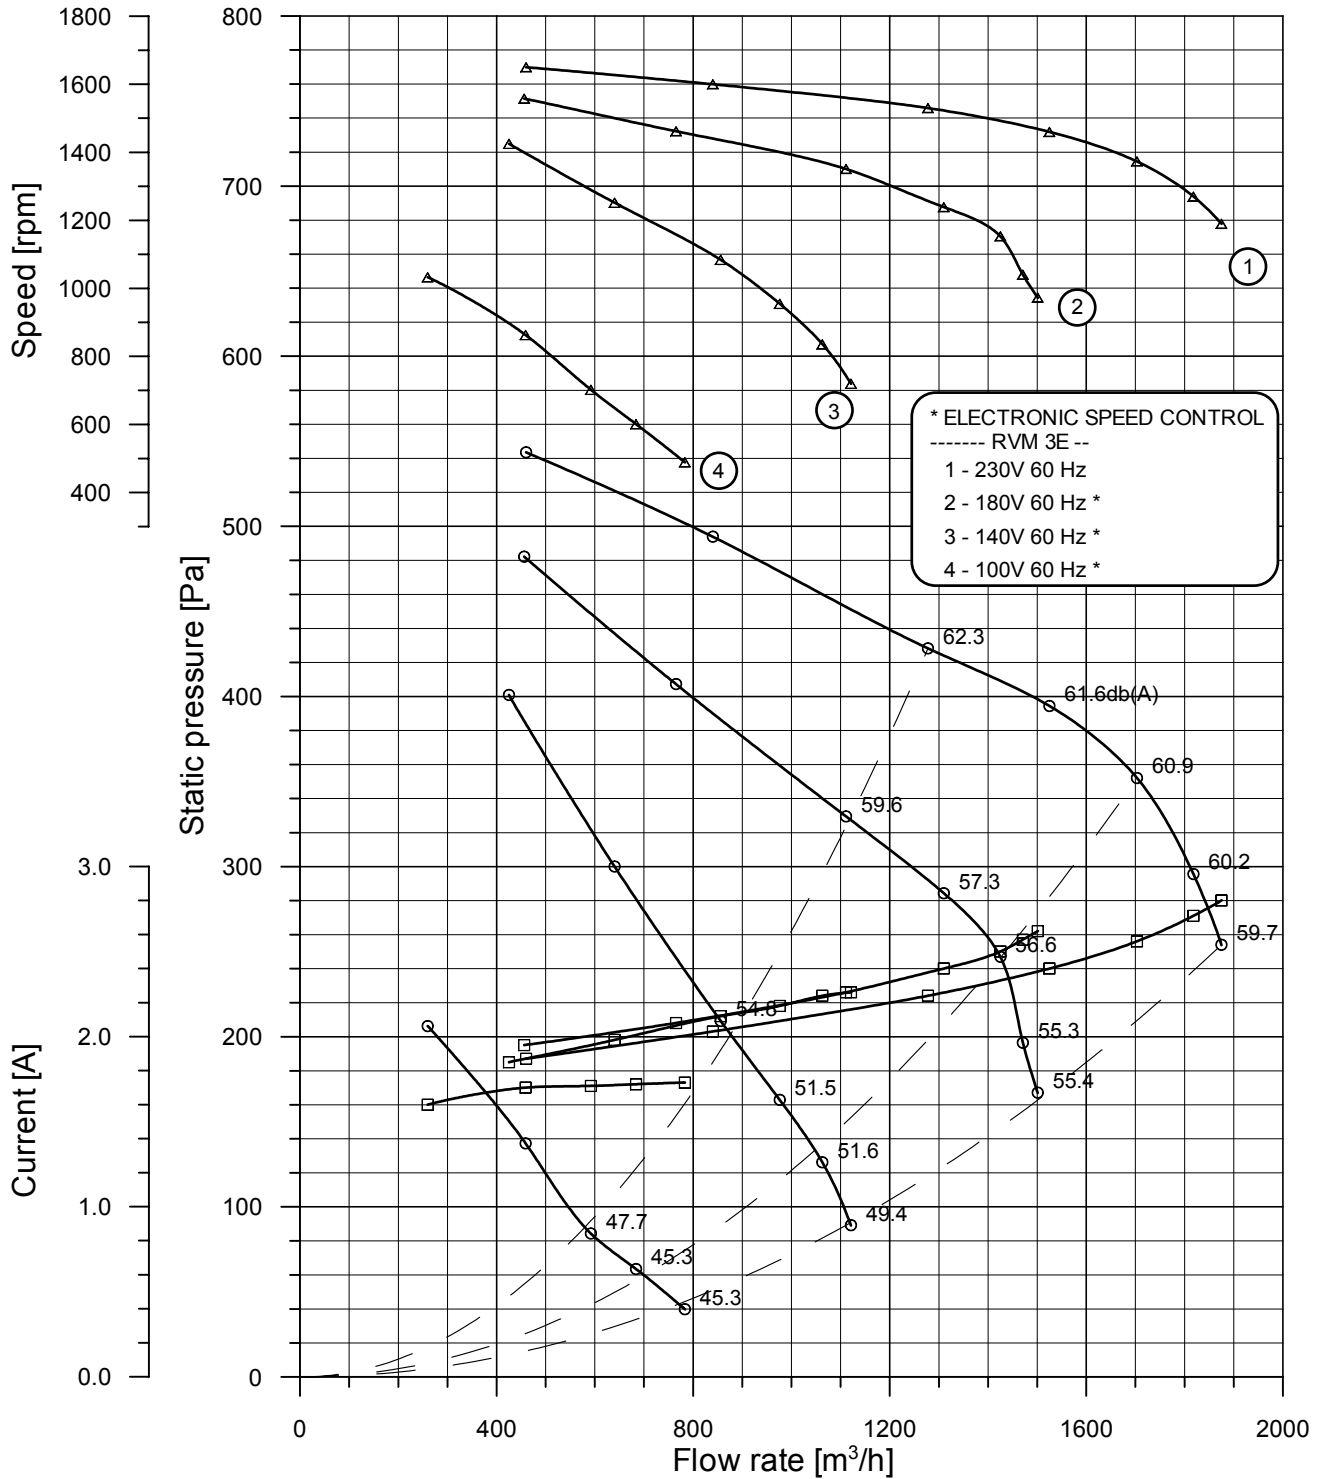

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.