




Zingonia
 Fan test laboratory
 AMCA 210/99 Fig. 12
 10000 m³/h test chamber

Air Density (γ): 1.20 kg/m³
 Installation type "B" : free inlet, ducted outlet
 dB(A) free field noise measurements at 1 m

Type:	FD2 200/240 Spagna	Watt:	405	Amp Max:	2.7
Motor:	1413E5	Volt:	230 1~	Prot.:	IP 20
Test nr.:	S3170.*	Hz:	50	T.H.:	YES-IN
Date:	07/03/06	Poles:	4	Ins. Cl.:	F
		μ F:	10 / 450 V		

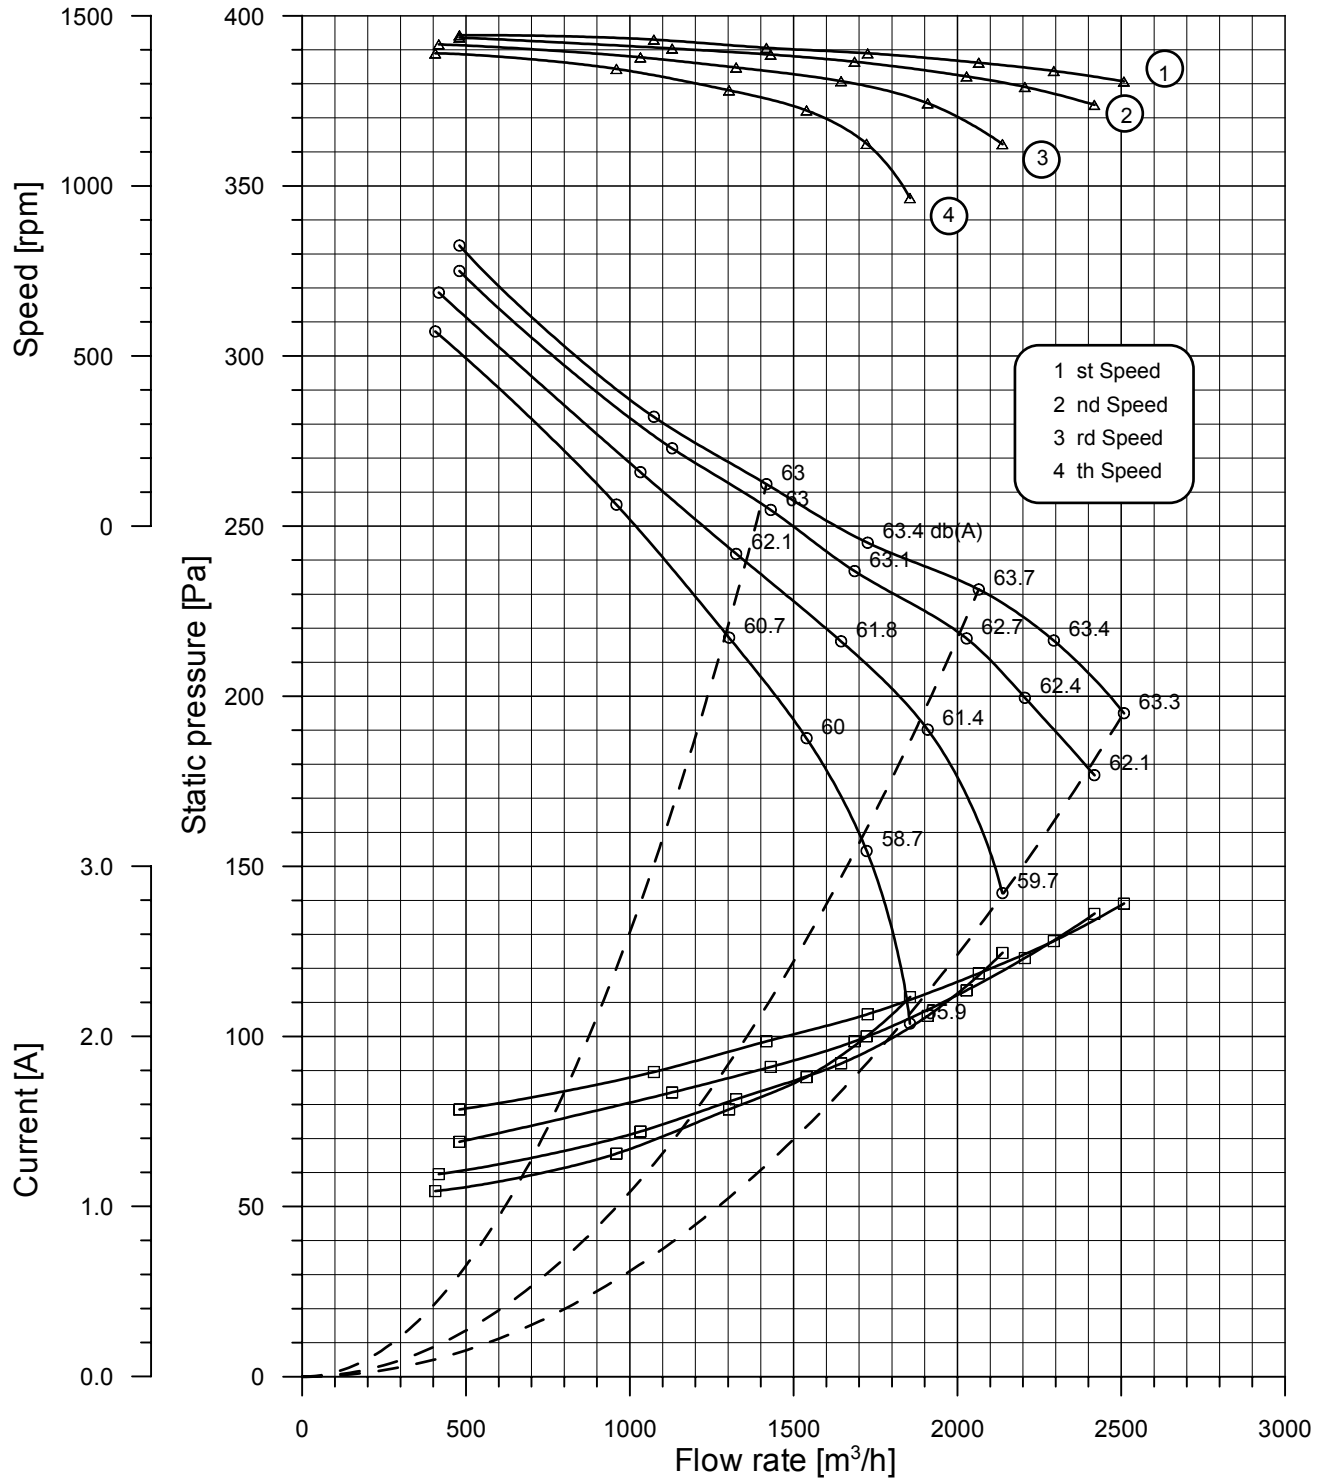

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.