

NICOTRA S.P.A.

FAN TEST LABORATORY

AMCA STANDARD 210/85 Fig. 12

50000 m³/h CHAMBER

TYPE AFG 630-30/6-6T-BNATT 350

MOTOR E6D3504 - 660404 VOLT 400

TEST 1808 HZ 50

DATE 11-11-1996

GAMMA = 1.214 Kg/m³ POLES 6

Installation type : free inlet * free outlet


db (A) free field noise measurements at m 3

AMP MAX 1.38

PROT. IP 54

T.H. YES

INS.CL. F

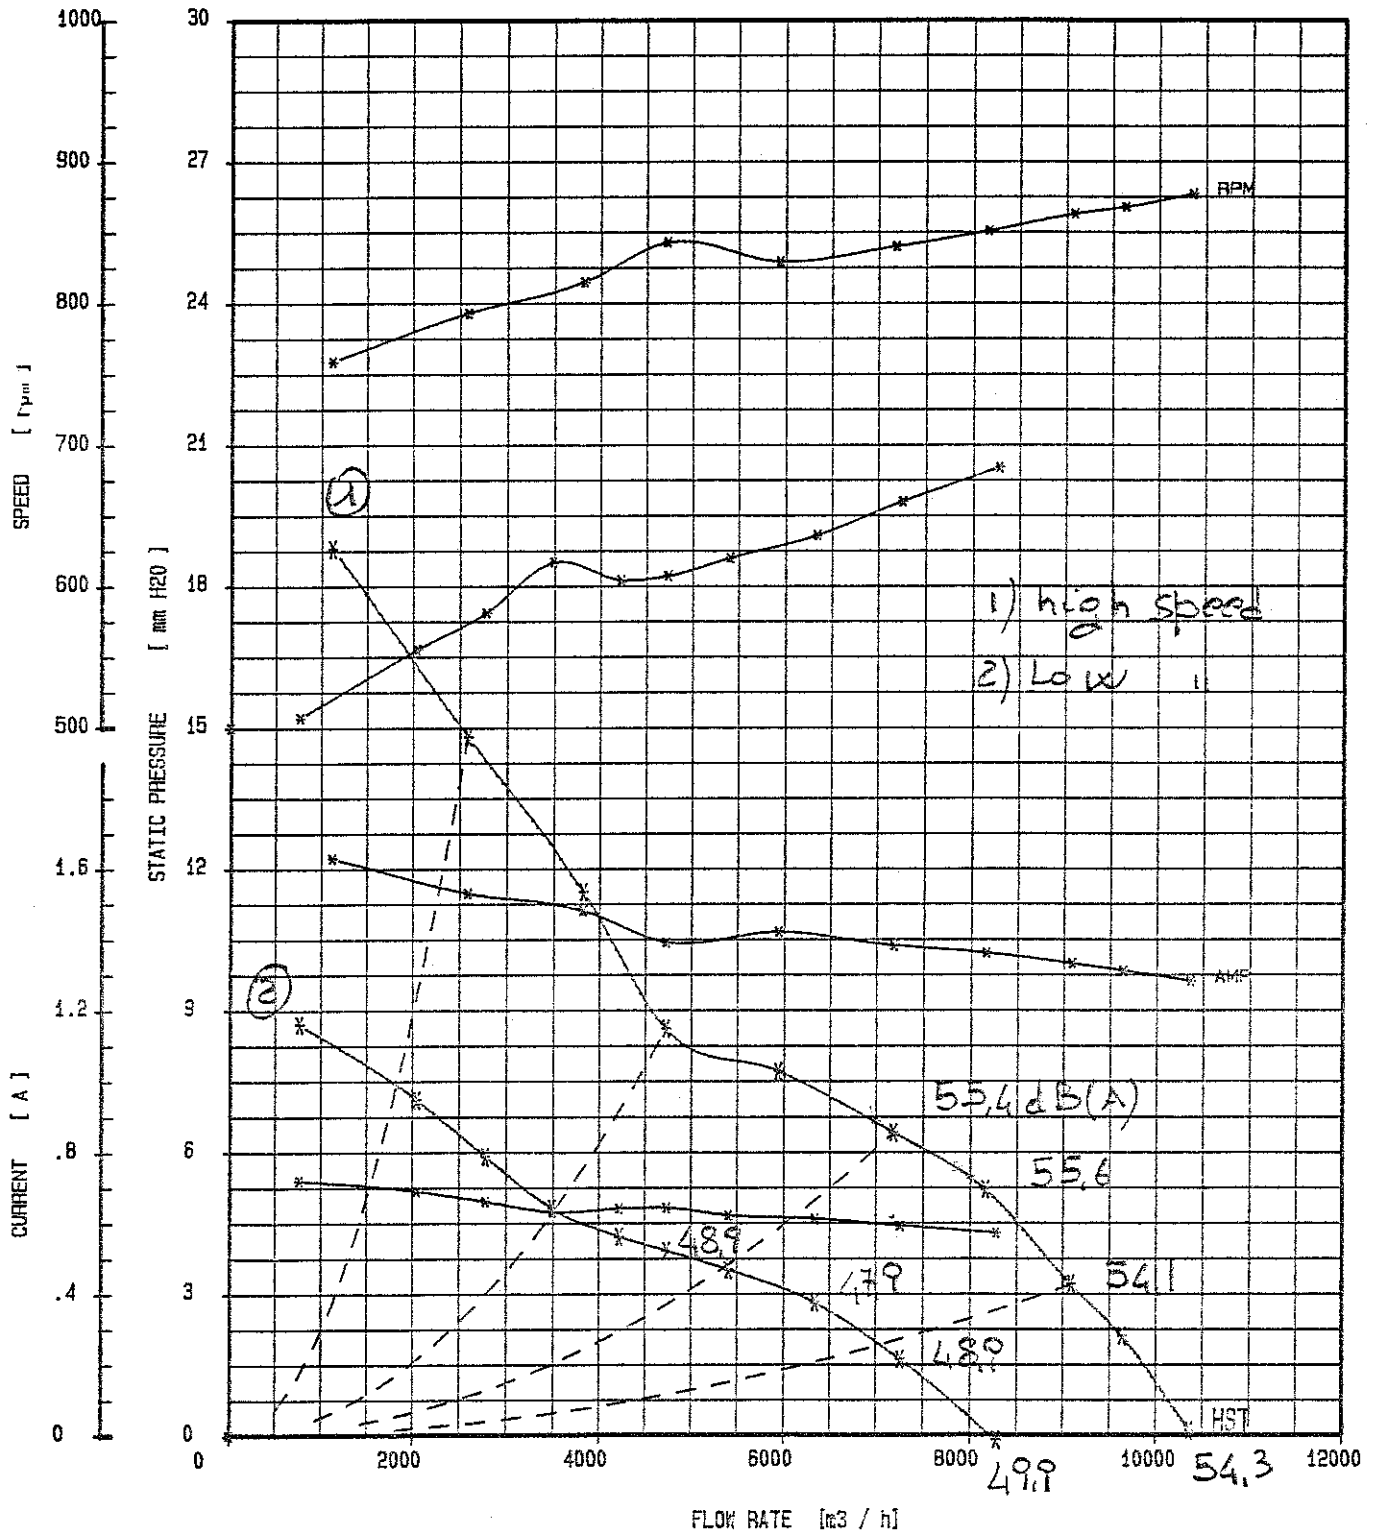

This test data obtained in a laboratory registered by AMCA, for AMCA 210 Air performance testing.
Data is not certified by AMCA.

NICOTRA S.P.A.

FAN TEST LABORATORY


AMCA STANDARD 210/85 Fig. 12

50000 m³/h CHAMBER

TYPE AFG 630-30/6-6T-BHATT 350
 MOTOR ~~ED4504~~ VOLT 400
 TEST 1808.2 HZ 60
 DATE 11-11-1996
 GAMMA = 1.214 Kg/m³ POLES 6

AMP MAX 1.5
 PROT. IP 54
 T.H. YES
 INS.CL. F

Installation type : free inlet * free outlet
 db(A) free field noise measurements at m 3

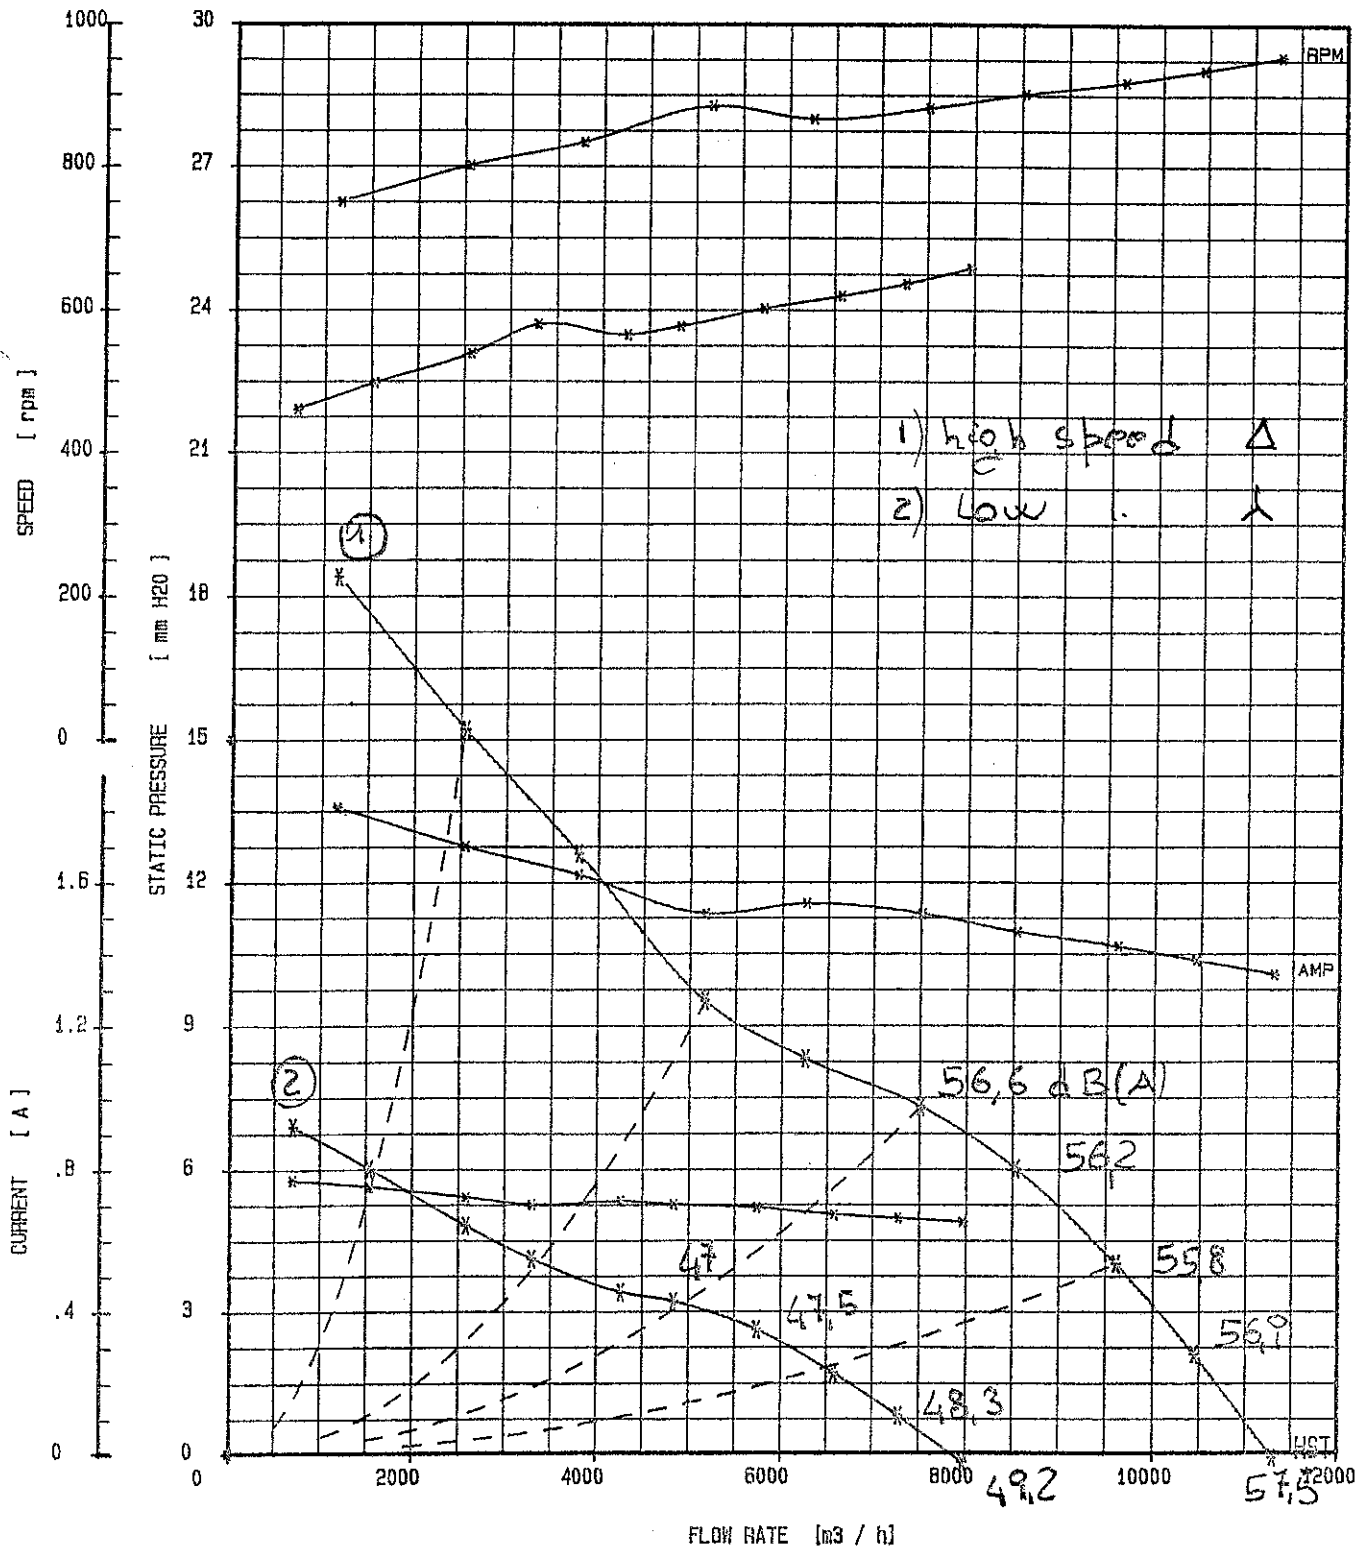

This test data obtained in a laboratory registered by AMCA, for AMCA 210 Air performance testing.

Data is not certified by AMCA.