




Zingonia
 Fan test laboratory
 AMCA 210/99 Fig. 12
 10000 m³/h test chamber

Air Density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 dB(A) free field noise measurements at 1 m

Type:	DDM 10/8	Watt:	280	Amp Max:	2.85
Motor:	E6G3404	Volt:	230	Prot.:	IP 44
Test nr.:	1724.*	Hz:	50	T.H.:	YES-OUT
Date:	18/03/96	Poles:	6	Ins. Cl.:	F
		μ F:	12.5 / 450 V		

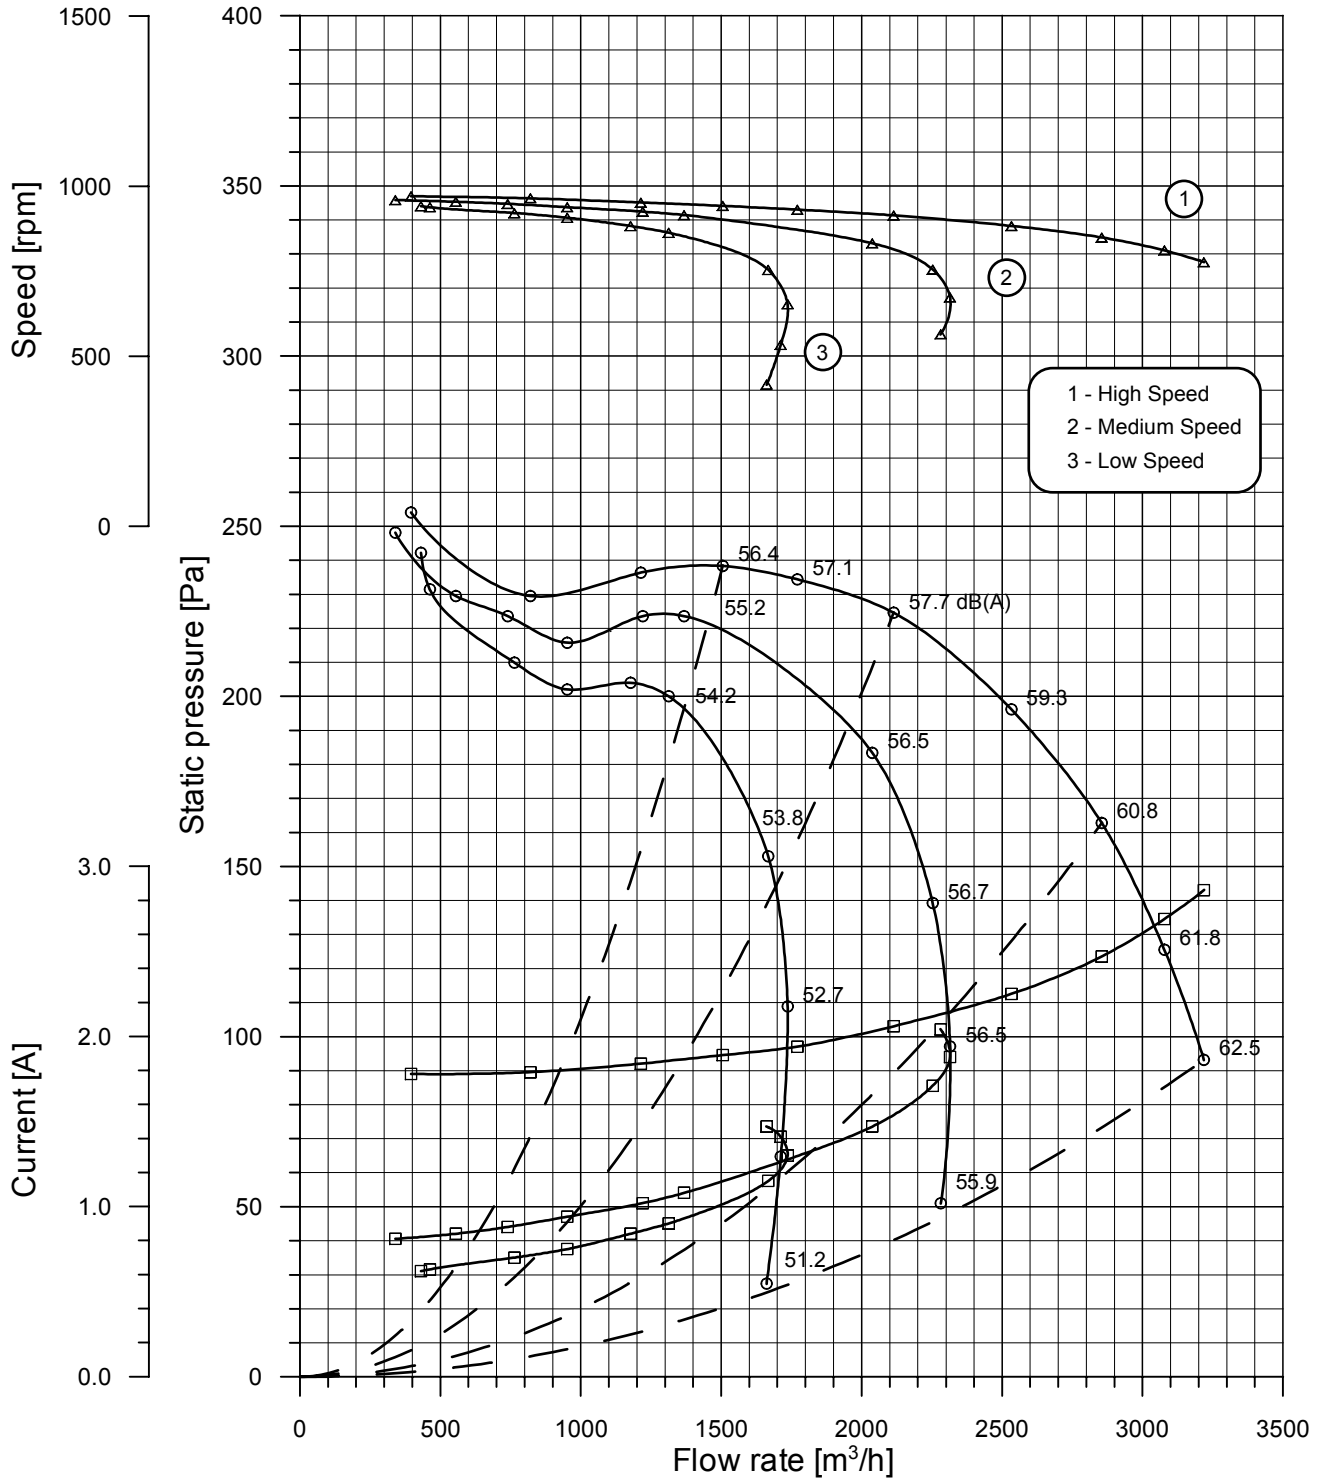

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.