




Zingonia
 Fan test laboratory
 AMCA 210/99 Fig. 12
 10000 m³/h test chamber

Air Density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 dB(A) free field noise measurements at 1 m

Type:	DD 9/7	Watt:	245	Amp Max:	2.1
Motor:	141951	Volt:	230 1~	Prot.:	IP 32
Test nr.:	3058.*	Hz:	50	T.H.:	YES-IN
Date:	08/09/05	Poles:	6	Ins. Cl.:	F
		μ F:	8 / 500 V		

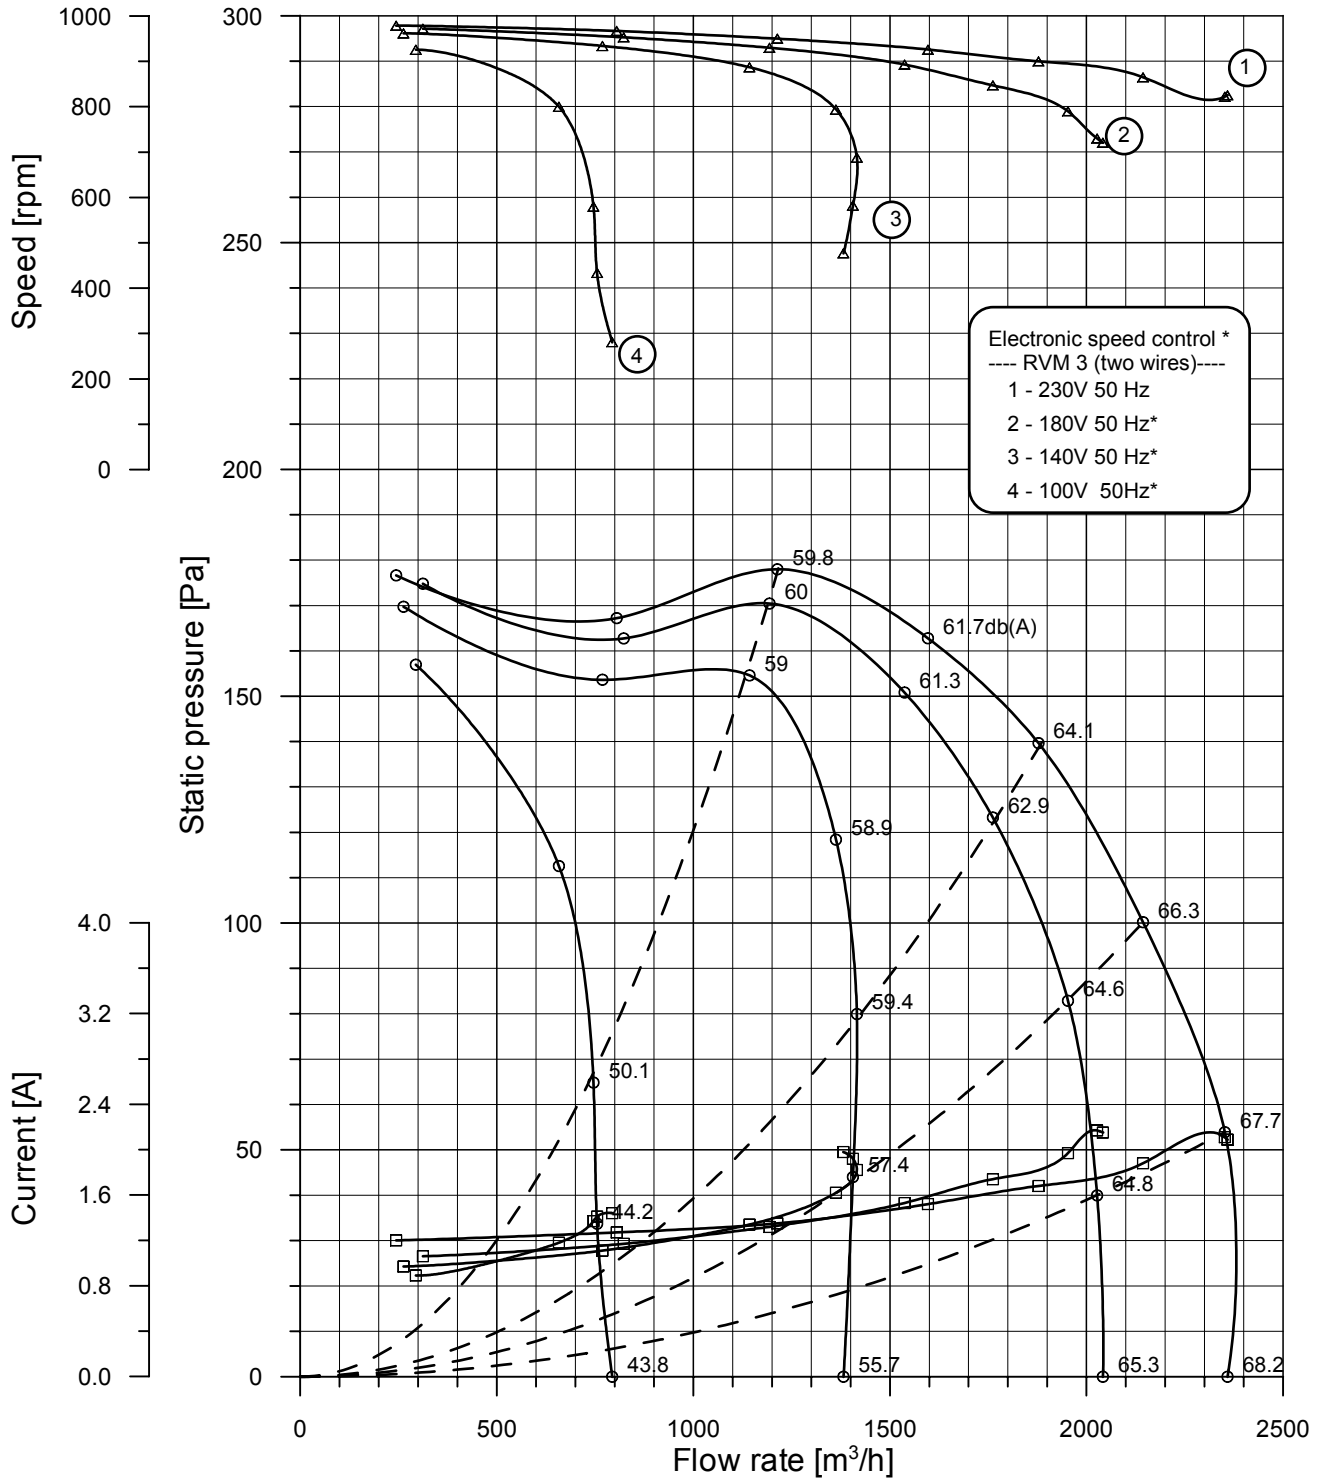

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.